



SIDEWALK ONLY

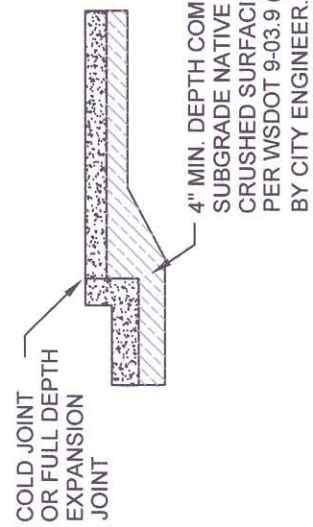

SIDEWALK WITH CURB & GUTTER

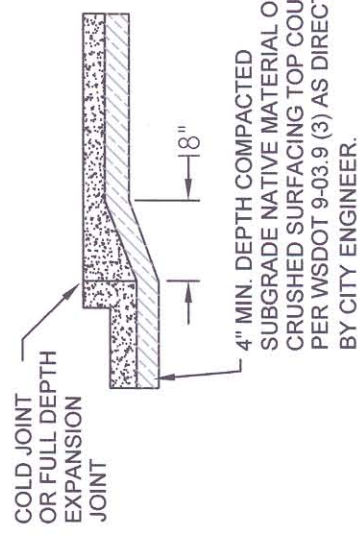

SIDEWALK WITH THICKENED EDGE

- NOTES:**
1. CONCRETE SHALL BE CLASS 3000 AIR ENTRAINED.
 2. THICKNESS SHALL BE 4" (TYPICAL) EXCEPT AT DRIVEWAYS WHICH SHALL BE 6" THICK.
 3. THICKEN EDGE SHALL BE USED ON COMMERCIAL CORNERS AND 2 1/2 FEET ON BOTH SIDES OF A COMMERCIAL DRIVEWAY.
 4. SIDEWALK SHALL DRAIN TOWARD THE STREET.
 5. BROOM FINISH SURFACE WITH TOOLED JOINTS AND EDGES.
 6. EXPANSION JOINT MATERIAL SHALL BE USED BETWEEN DRIVEWAYS AND SIDEWALK JOINT.

SIDEWALK WIDTHS

RESIDENTIAL & COMMERCIAL	5'
ARTERIALS	6'
TOWN CENTER	10'
USE AS MULTI-PURPOSE TRAIL	10'

DEPARTMENT OF PUBLIC WORKS

STANDARD PLANS STR 03a

CONCRETE SIDEWALK

APPROVED: *Douglas Jefferson*

Director of Public Works/City Engineer

REVISION: MAY.2005 NOT TO SCALE BY: LC