


CB OUT IN ROADWAY

PATCH AREA
SEE NOTE 1


SEAL JOINTS WITH HOT
ASPHALT CEMENT (AR4000W)

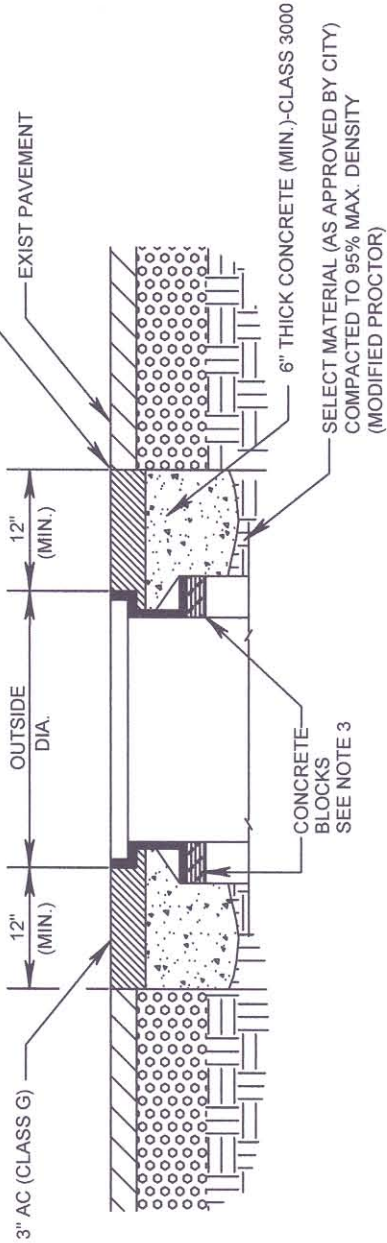

SECTION

NOTES:

1. REMOVE PAVEMENT AND BASE MATERIALS MINIMUM 12" OUT FROM FRAME.
2. DURING OVERLAY PROJECTS, ADJUSTMENTS MUST BE DONE AFTER THE PLACEMENT OF THE NEW ASPHALT ROAD SURFACE.
3. ADJUST CASTING FRAME TO NEW PAVEMENT SURFACE USING CONCRETE BLOCKS. 2"x4"x8" SOLID BRICK WITH GROUT SHALL BE USED FOR FINAL ADJUSTMENT TO GRADE, 6" HIGH MAXIMUM.

 DEPARTMENT OF PUBLIC WORKS	STANDARD PLANS STR 040
	GENERAL UTILITY ADJUSTMENT APPROVED: <i>Angela Jefferson</i> Director of Public Works/City Engineer
REVISION: JAN 2003	NOT TO SCALE
BY: L.C.	BY: L.C.