


TRENCH IN UNPAVED AREA

(OFF ROADWAY)

TRENCH IN PAVED AREA

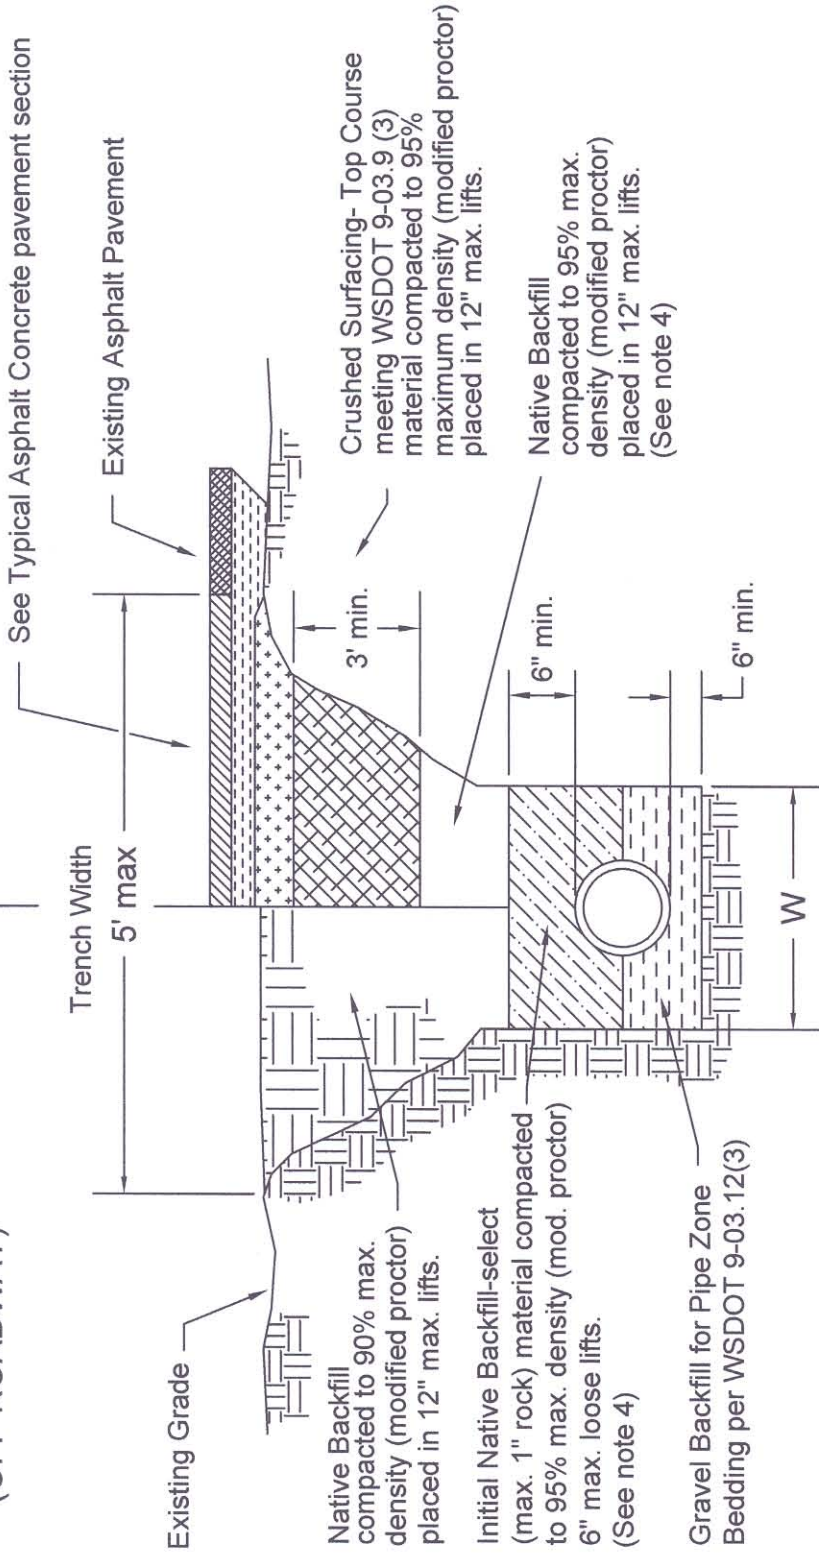

NOTES:

1. Existing Asphalt pavement must be sawcut to provide a clean straight edge before pipe placement.
2. Existing material disturbed under the pipe shall be replaced with bedding material and compacted to 95% max. density.
3. Backfill material shall be installed in an approved manner to insure no damages to the pipe.
4. If native backfill is determined unsatisfactory by the City, use Crushed Surfacing- Top Course per WSDOT 9-03.9 (3)



STANDARD PLANS	STR 062
TYPICAL TRENCH DETAIL	
Approved: <i>Stephen Jefferson</i>	
Director of Public Works/City Engineer	
Revision: DEC. 02	Not To Scale
	By: L. C.

W = 40" for 15" diameter pipe & smaller.
 W = 1 1/2" x pipe diameter + 18" for pipe 18" in diameter and larger.